


# Dry Hydrant Assembly

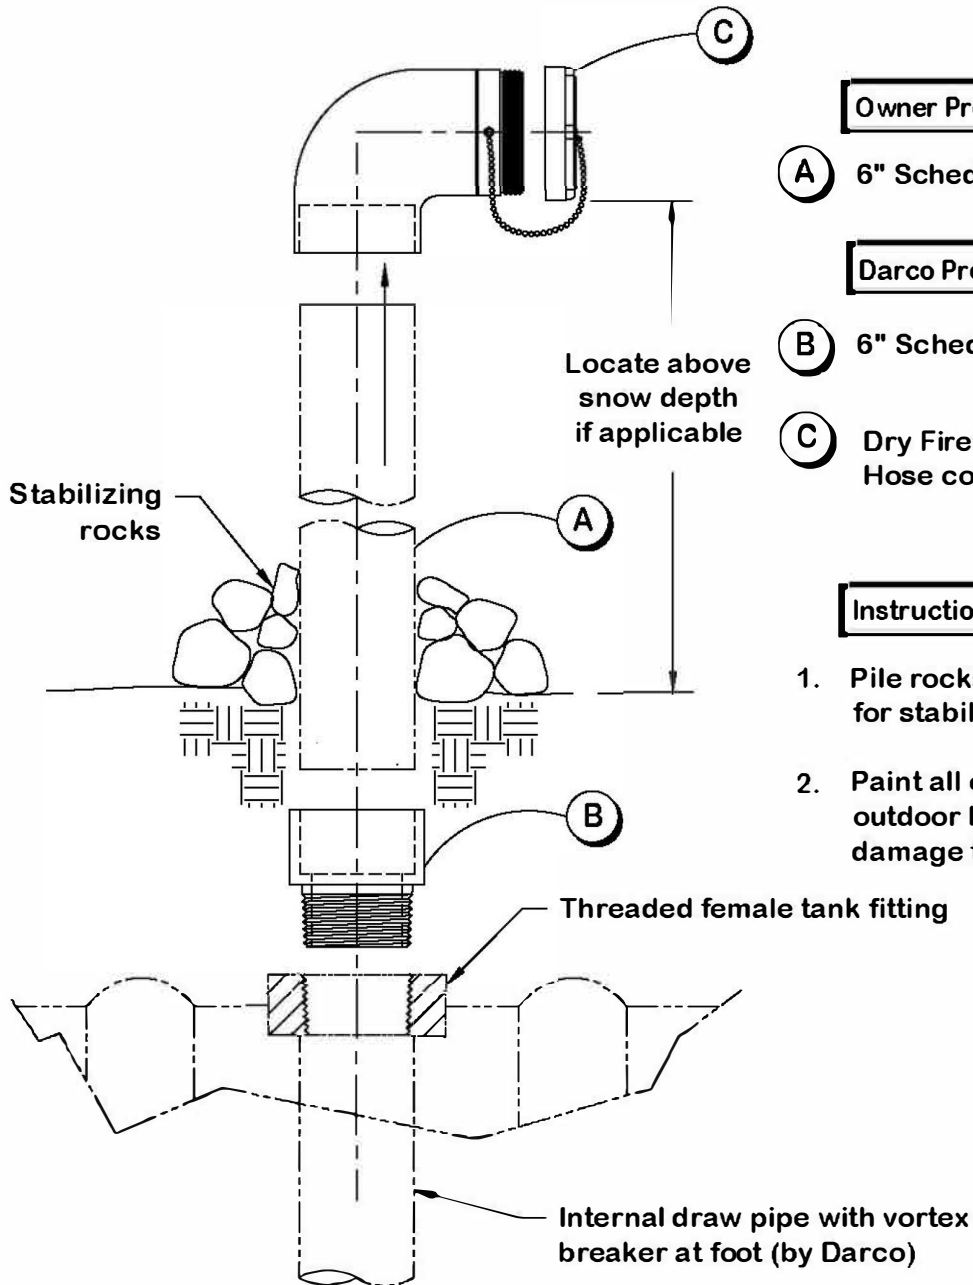

### Owner Provided Materials

- (A) 6" Schedule 40 PVC pipe - length as needed

### Darco Provided Components

- (B) 6" Schedule 80 male threaded tank adapter
- (C) Dry Fire Hydrant head assembly.  
Hose coupling type and size to be determined.

### Instructions

1. Pile rocks around the base of the riser for stabilization.
2. Paint all exposed plastic parts with outdoor latex paint to avoid long term UV damage from sunlight.